


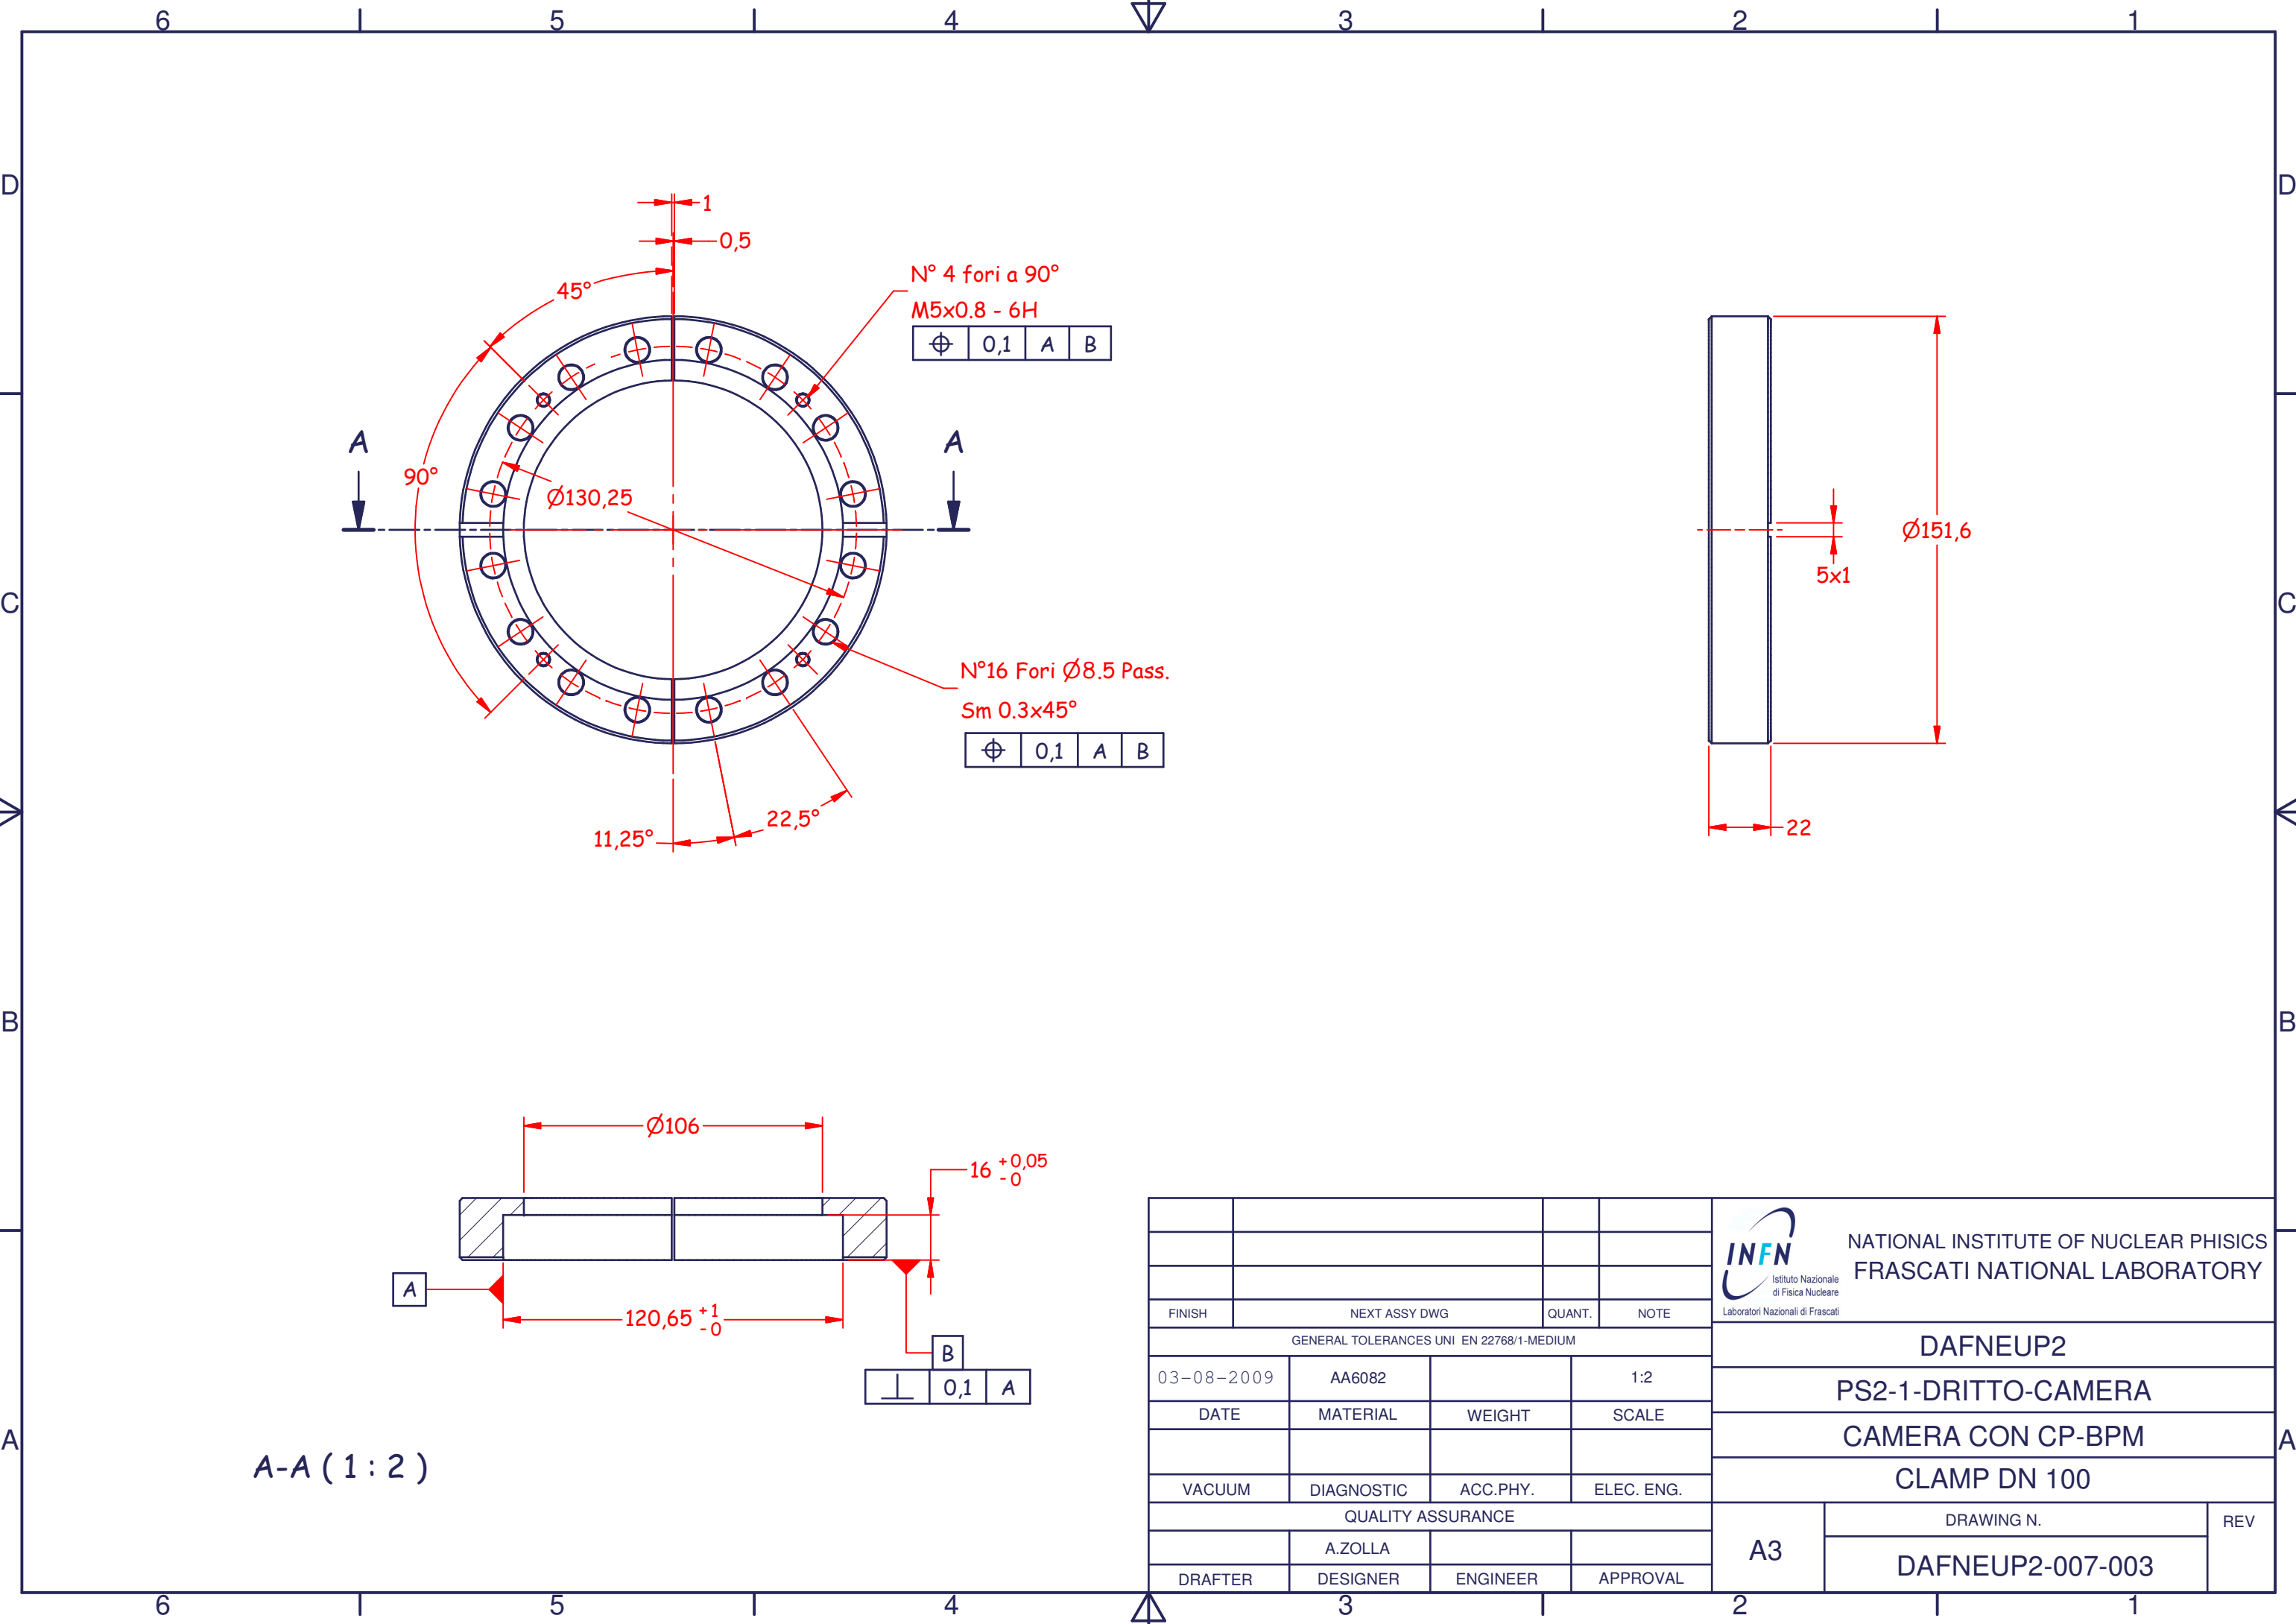

D

C

B

A

D

C

B

A

A-A (1 : 2)

				 NATIONAL INSTITUTE OF NUCLEAR PHISICS FRASCATI NATIONAL LABORATORY Istituto Nazionale di Fisica Nucleare Laboratori Nazionali di Frascati		
FINISH	NEXT ASSY DWG	QUANT.	NOTE			
GENERAL TOLERANCES UNI EN 22768/1-MEDIUM				DAFNEUP2		
03-08-2009	AA6082		1:2	PS2-1-DRITTO-CAMERA		
DATE	MATERIAL	WEIGHT	SCALE	CAMERA CON CP-BPM		
				CLAMP DN 100		
VACUUM	DIAGNOSTIC	ACC.PHY.	ELEC. ENG.			
QUALITY ASSURANCE				A3	DRAWING N.	REV
	A.ZOLLA				DAFNEUP2-007-003	
DRAFTER	DESIGNER	ENGINEER	APPROVAL			