

D

C

B



A

D

C

B

A

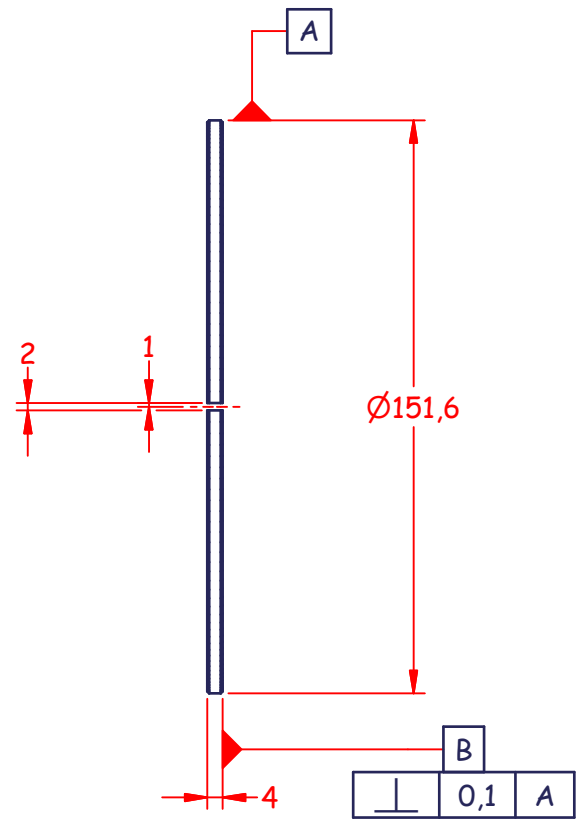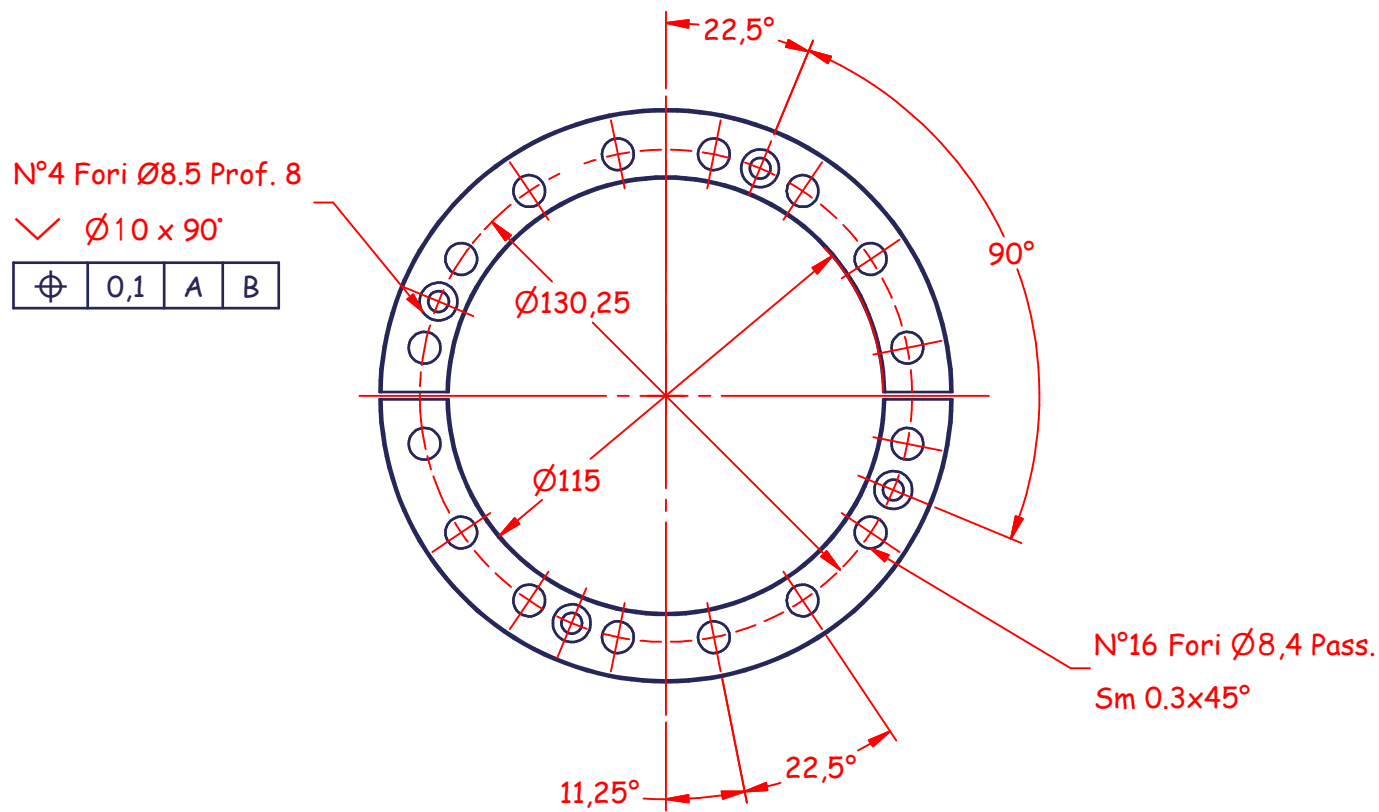

				 NATIONAL INSTITUTE OF NUCLEAR PHYSICS FRASCATI NATIONAL LABORATORY Istituto Nazionale di Fisica Nucleare Laboratori Nazionali di Frascati	
FINISH	NEXT ASSY DWG	QUANT.	NOTE		
GENERAL TOLERANCES UNI EN 22768/1-MEDIUM				DAFNEUP2	
03-08-2009	AA6082		1:2	ES1-3-DRITTO-CAMERA	
DATE	MATERIAL	WEIGHT	SCALE	CAMERA CON CP-BPM	
				EXTERNAL CLAMP DN 100	
VACUUM	DIAGNOSTIC	ACC.PHY.	ELEC. ENG.	A3	
QUALITY ASSURANCE					
	A.ZOLLA				
DRAFTER	DESIGNER	ENGINEER	APPROVAL		
				DRAWING N.	REV
				DAFNEUP2-009-005	